

TOP VIEW

NOTES:


1 TO COMPLY WITH ANSI Z358.1-2014 FOR EMERGENCY EYEWASH:

UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.

EYEWASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THAN 83.8 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.

2 EYEWASH HEAD ASSEMBLY MUST BE PARALLEL TO WALL OR OBSTRUCTION TO MEET CRITERIA STATED IN ACCORDANCE TO NOTE 1.

* 3. DIMENSIONS MAY VARY ±1/2" [12.7mm].

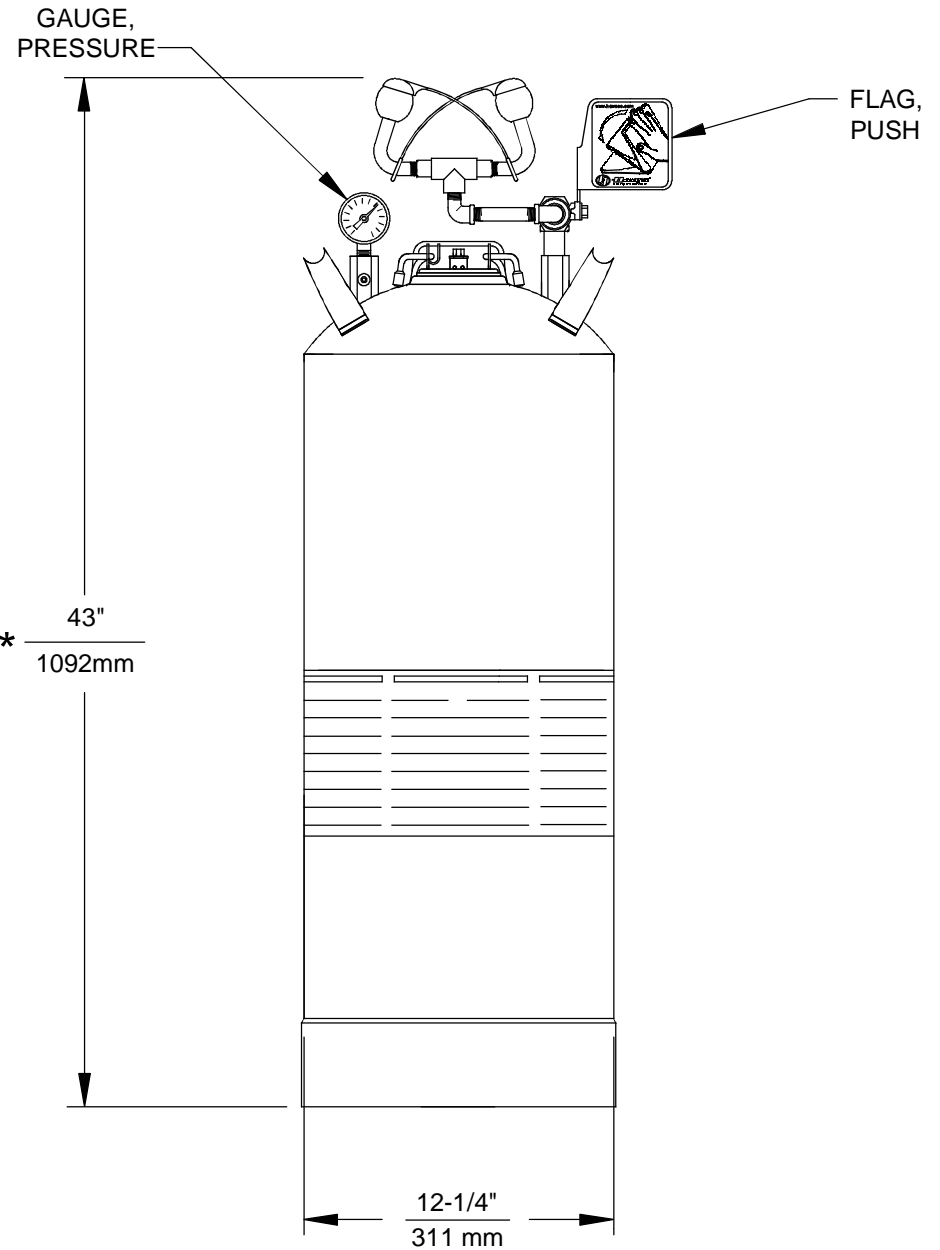

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO.:	REVISED PER BY:	MODEL(S)	PART NUMBER
ECN: 4967	HM	7602.15	0002080053.D
DRAWN: DZ	DATE: 2/98	CHK'D: RVH	REVISION
APPROVED: FV	DATE: 06/17/15	SCALE: 1:8	14
DRAWING TYPE: INSTALLATION		SIZE: A	SHEET 1 OF 1