



**INSTALLATION, OPERATION  
&  
MAINTENANCE INSTRUCTIONS**

1455 Kleppe Lane ♦ Sparks, NV 89431-6467 ♦ (775) 359-4712 ♦ Fax (775) 359-7424  
E-mail: [haws@hawsco.com](mailto:haws@hawsco.com) ♦ website: [www.hawsco.com](http://www.hawsco.com)

No. 2080078(2)

**Model 7655WCC  
Eye/face Wash**

**NOTE TO INSTALLER: Please leave this information with the Maintenance Department.**

**LIMITED WARRANTY**

HAWS® warrants that all of its products are guaranteed against defective material or poor workmanship for a period of **one year from date of shipment**. HAWS liability under this warranty shall be discharged by furnishing without charge F.O.B. HAWS Factory any goods, or part thereof, which shall appear to the Company upon inspection to be of defective material or not of first class workmanship, provided that claim is made in writing to company within a reasonable period after receipt of the product. Where claims for defects are made, the defective part or parts shall be delivered to the Company, prepaid, for inspection. HAWS will not be liable for the cost of repairs, alterations or replacements, or for any expense connected therewith made by the owner or his agents, except upon written authority from HAWS, Sparks, Nevada. HAWS will not be liable for any damages caused by defective materials or poor workmanship, except for replacements, as provided above. Buyer agrees that Haws has made no other warranties either expressed or implied in addition to those above stated, except that of title with respect to any of the products or equipment sold hereunder and that HAWS shall not be liable for general, special, or consequential damages claimed to arise under the contract of sale.

The emergency equipment manufactured by HAWS is warranted to function if installation and maintenance instructions provided are adhered to. The units also must be used for the purpose, which they were intended. This product is intended to supplement first-aid treatment. Due to widely varying conditions HAWS cannot guarantee that the use of this emergency equipment will prevent serious injury or the aggravation of existing or prior injuries.

**NO OTHER WARRANTIES EXPRESSED OR IMPLIED ARE AUTHORIZED,  
PROVIDED OR GIVEN BY HAWS.**

**SHOULD YOU EXPERIENCE DIFFICULTY WITH THE INSTALLATION OF THIS  
MODEL PLEASE CALL:**

**TECHNICAL SUPPORT: 1-800-766-5612**

**FOR CUSTOMER SERVICE: 1-888-640-4297**

**RECOMMENDED TOOLS:** Adjustable wrench, pipe wrench, pipe joint sealant, Phillips screw driver, 1/4" hex key wrench.

**LOCATION OF UNIT:** The Model 7655WCC eye/face wash should be installed in close proximity to potential accident areas. It should be clearly identified free from obstructions and easy to access. See ANSI Z358.1 guidelines for more information.

**SUPPLY LINE:** The minimum recommended line size is 1/2" IPS with 30-90 psi (2-6 ATM) flowing pressure at supply inlet. Where sediment or mineral content is a problem, an inlet filter is recommended.

**PLUMBING CONNECTIONS:** Inlet supply is male 1/2" IPS, no drain.

### CLEANING INSTRUCTIONS FOR STAINLESS BEAD-BLASTED PRODUCTS

Haws recommended cleaning procedure for stainless bead blasted products is as follows:

1. Use a stainless steel polish and cleaner for removing stains and finger prints.
2. Spray cleaner onto stainless surfaces and wipe dry with clean cloth. Cleaned surface will resist new stains and fingerprints.

### INCLUDED PARTS


MODEL PACKAGE	QUANTITY	ITEMS INCLUDED
7655WCC	1	Mounting Frame/Eyewash assembly
	1	Emergency Eyewash Sign
	1	Test Tag


### TROUBLESHOOTING

PROBLEM	REPAIR CHECKLIST
1. No flow.	1a. Check the main shut-off valve.
2. Insufficient water flow at eye/face wash.	2a. Verify minimum 30 psi (2 ATM) flowing supply line pressure. b. Probable clogging of flow control due to inadequate line flushing. Unscrew eye/face wash head and remove the four screws to disassemble head. Clean flow control and reassemble head. c. Remove cap located on L – Strainer using a 1/4" allen wrench to access and clean filter screen.
3. Eye/face wash streams do not meet desired eye level.	3a. Possible blocked flow control, see above solution. b. Possible non-leveled eye/face wash assembly.



For more information about Haws products, see our website: [www.hawsco.com](http://www.hawsco.com).

# PARTS BREAKDOWN

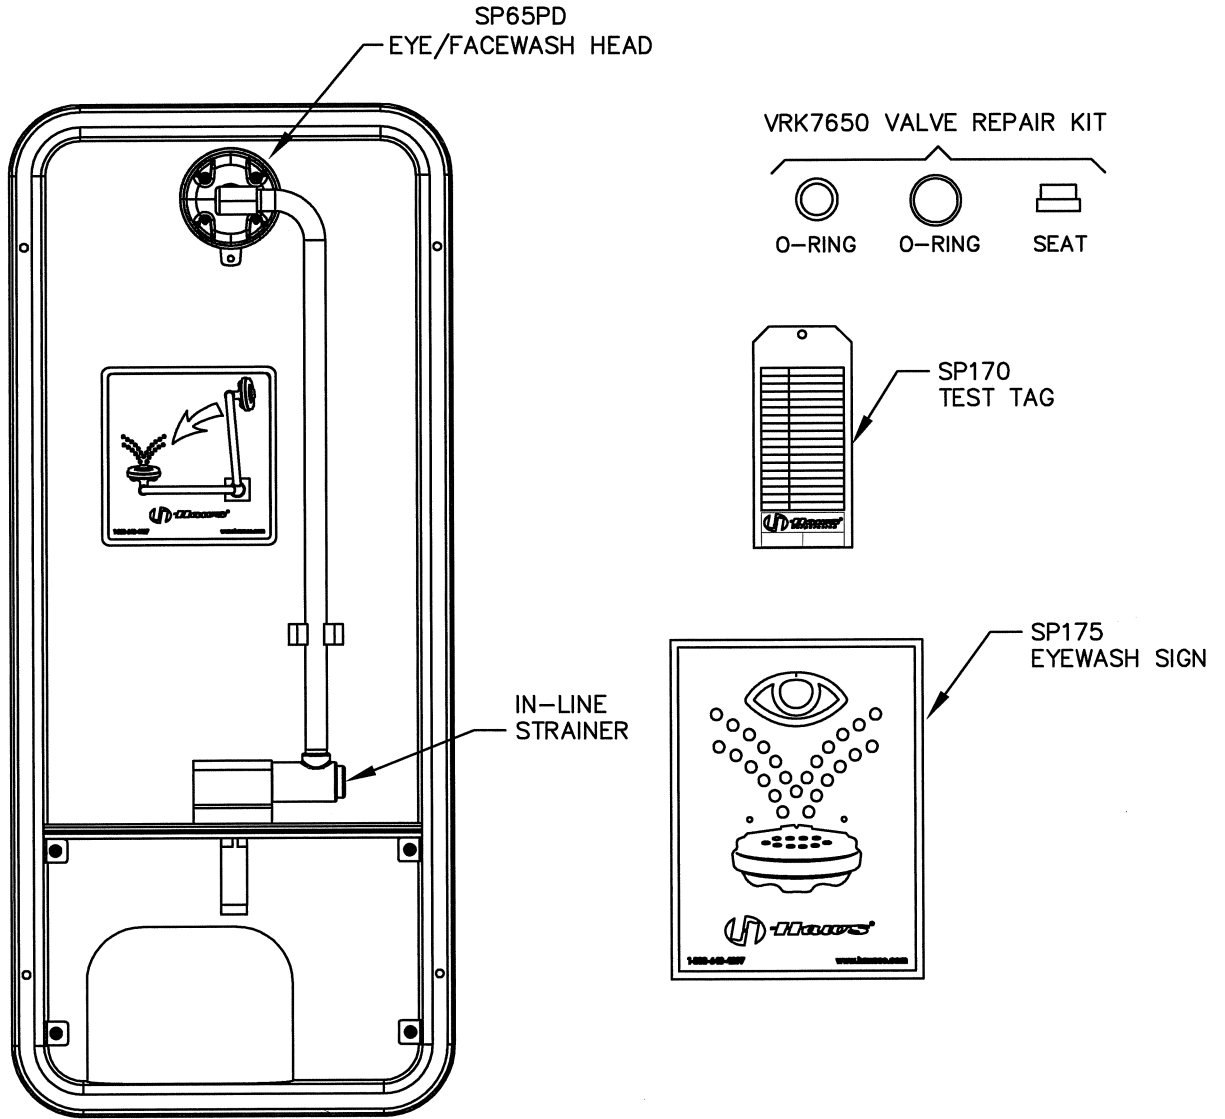

 <b>Haws</b> <sup>®</sup>			1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM		
ECN NO. 4290	REVISED PER BY: ECN: 4572 IIR	MODEL(S)	PART NUMBER: 0002080078		
DRAWN: IIR	DATE: 2/4/10	CHKD: IIR	7655WCC	DRAWING NO.: 16036A00	REV: 2
APPROVED: [Signature]	DATE: [Signature]	SCALE: 1/3	DRAWING TYPE: PARTS BREAKDOWN	SIZE: A	SHEET 1 OF 1

**WHEN ORDERING PARTS PLEASE SPECIFY YOUR MODEL NUMBER**

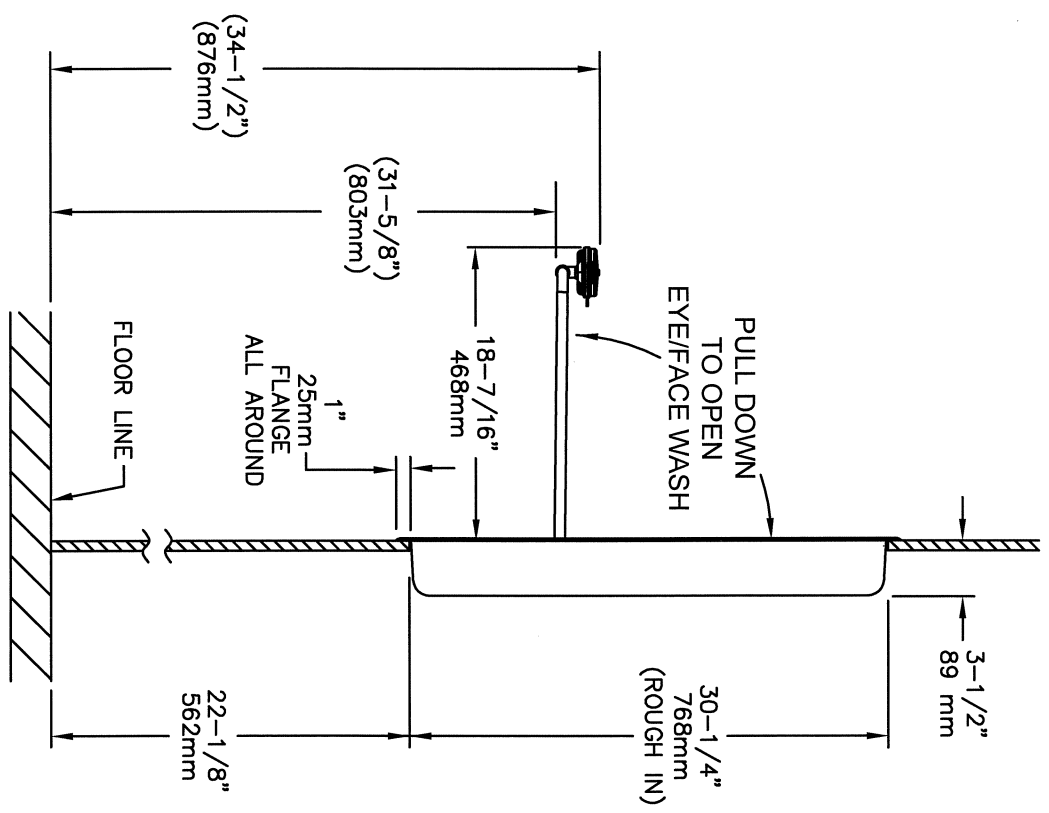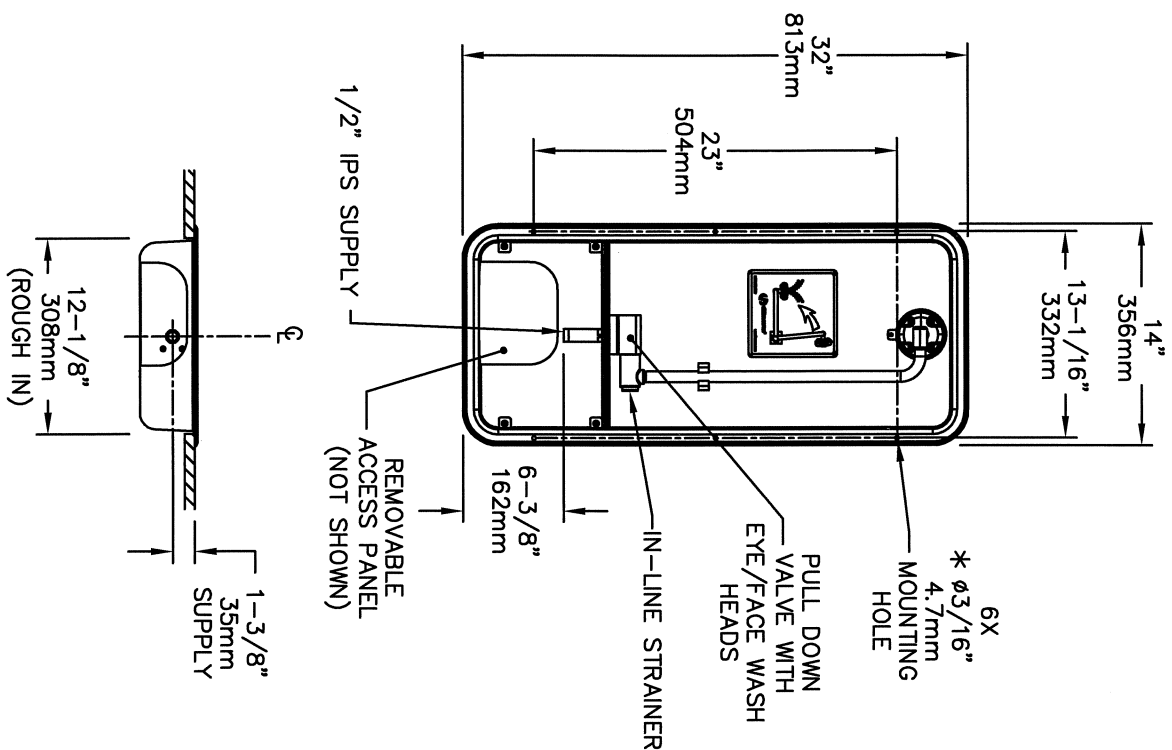

NOTES:

1. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO. WASTE CONNECTION MUST ADHERE TO LOCAL HEALTH AND PLUMBING CODES.
2. FLOW RATE FOR EYE/FACE WASH IS 3.7 GPM AND EXCEEDS ANSI STANDARD Z358.1.
3. DIMENSIONS MAY VARY BY  $\pm 1/2"$  [12.7mm].
- \*4. MOUNTING HARDWARE NOT SUPPLIED.

©2011 Haws Corporation - All Rights Reserved HAWWS® and other trademarks used in these materials are the exclusive property of Haws Corporation.

		<b>Haws</b>	
1456 KLEPPE LANE SPARKS, NEVADA 89431 (775) 358-4712 FAX (775) 358-7424 EMAIL: HAWWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM		PART NUMBER: 0002080078.D DRAWING NO.: REV 1 16035A00 2	
EQUIPMENT NO. 4230	REVISION PERIOD: 4/27	MODEL(S): 7655VMCC	SCALE: 1:12
DRAWN: [Signature]	DATE: [Signature]	DATE: [Signature]	DRAWING TYPE: INSTALLATION
APPROVED: [Signature]	DATE: [Signature]	DATE: [Signature]	SIZE: A1 SHEET: 1 OF 1