
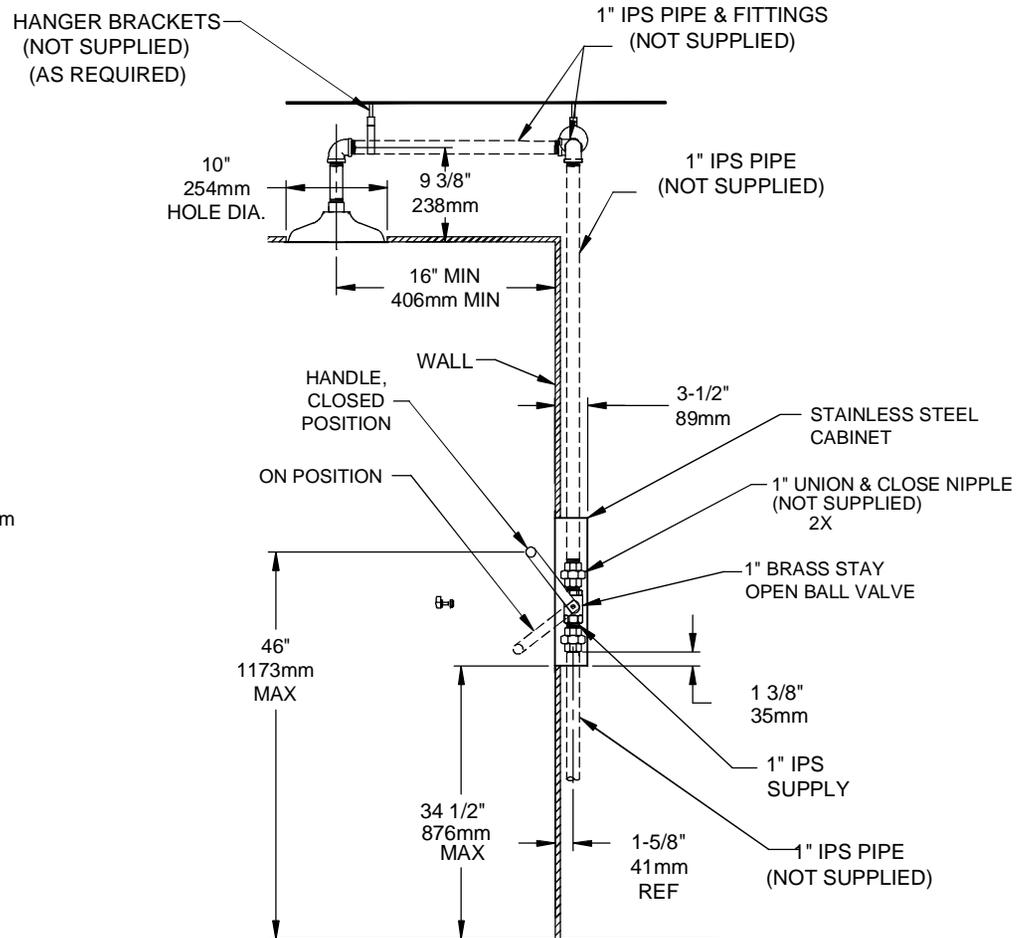


SEE SHT. 2 OF 2 FOR ALTERNATE "HANG DOWN" INSTALLATION

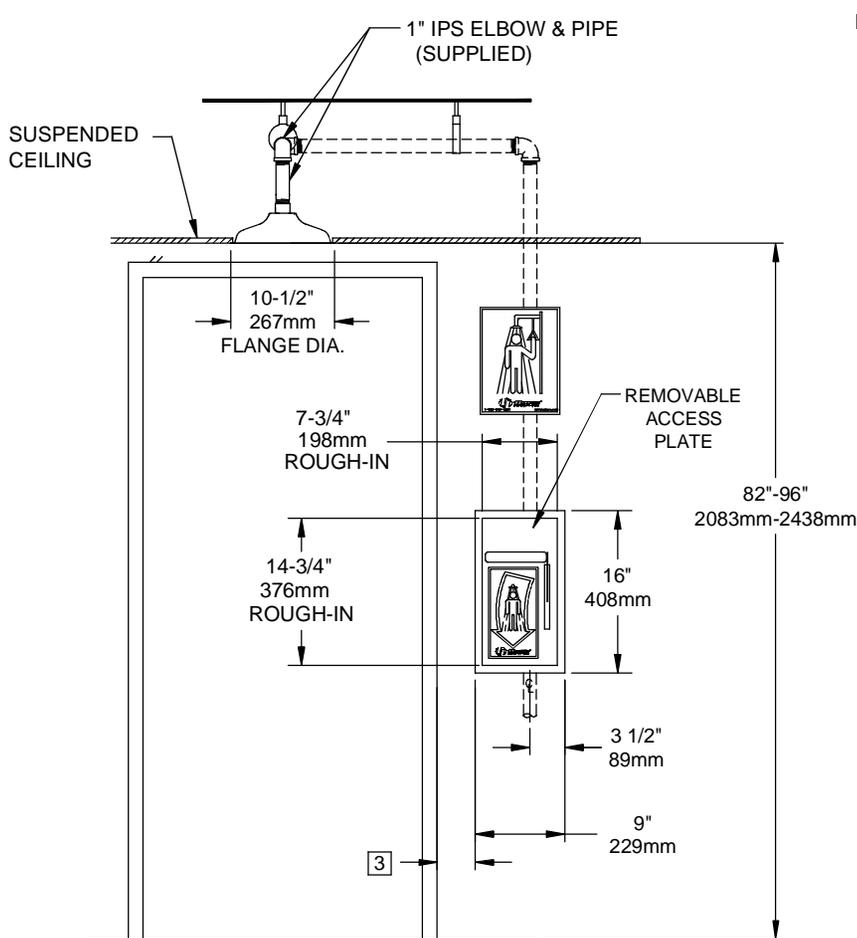


NOTES:

- TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY SHOWER EQUIPMENT:
 - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - SHOWER SHALL BE POSITIONED SO THAT SHOWER HEAD IS NOT LESS THAN 208.3 CM (82 IN.) NOR MORE THAN 243.8 CM (96 IN.) FROM SURFACE ON WHICH USER STANDS.
 - SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 50.8 CM (20 IN.) AT 152.4 CM (60 IN.) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED AT LEAST 40.6 CM (16 IN.) FROM ANY OBSTRUCTION.

- DIMENSIONS MAY VARY $\pm 1/2"$ [12.7mm].

- 3** INSTALL STAINLESS STEEL CABINET AS CLOSE TO DOOR JAM AS POSSIBLE.

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
ECN NO. REVISED PER BY:	ECN: 4838 HM	MODEL(S)	PART NUMBER:
DRAWN: DO	DATE: 03/09/00	CHKD: HM	8164
APPROVED:	DATE:	SHOWER	0002080138.D
SCALE: 1/19		DRAWING TYPE: INSTALLATION	DRAWING NO.: REV. 13622A00 14
SIZE: A		SHEET 1 OF 2	

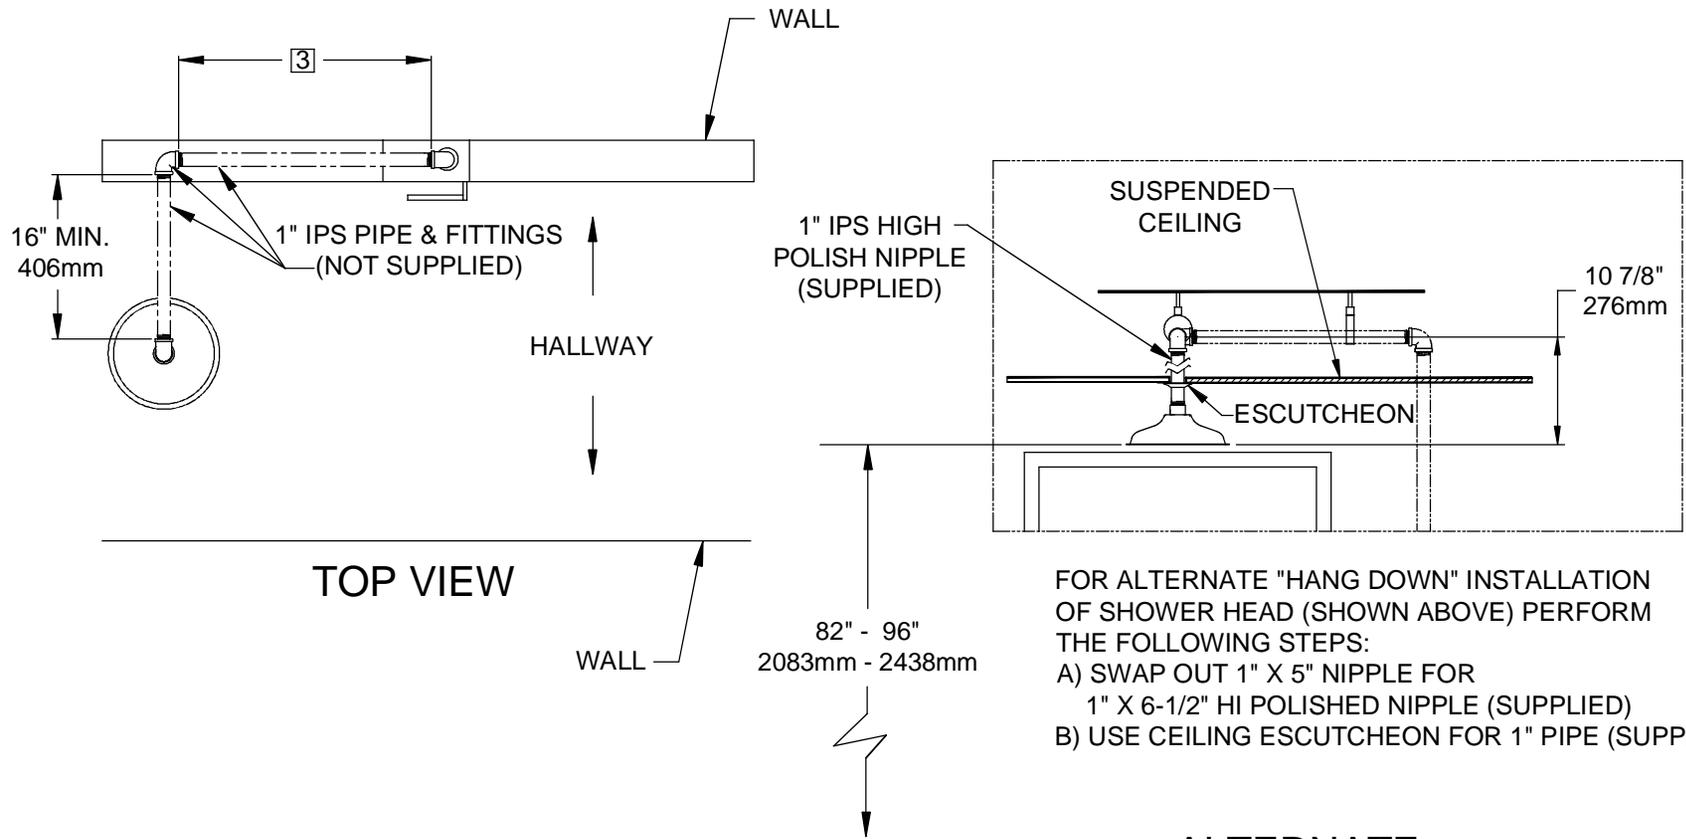

FOR ALTERNATE "HANG DOWN" INSTALLATION OF SHOWER HEAD (SHOWN ABOVE) PERFORM THE FOLLOWING STEPS:
 A) SWAP OUT 1" X 5" NIPPLE FOR 1" X 6-1/2" HI POLISHED NIPPLE (SUPPLIED)
 B) USE CEILING ESCUTCHEON FOR 1" PIPE (SUPPLIED)

ALTERNATE "HANG DOWN" INSTALLATION

NOTES:

1. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY SHOWER EQUIPMENT:
 - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - SHOWER SHALL BE POSITIONED SO THAT SHOWERHEAD IS NOT LESS THAN 208.3 CM (82 IN.) NOR MORE THAN 243.8 CM (96 IN.) FROM SURFACE ON WHICH USER STANDS.
 - SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 50.8 CM (20 IN.) AT 152.4 CM (60 IN.) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED AT LEAST 40.6 CM (16 IN.) FROM ANY OBSTRUCTION.

2. DIMENSIONS MAY VARY ±1/2" [12.7mm].

[3] INSTALL STAINLESS STEEL CABINET AS CLOSE TO DOOR JAM AS POSSIBLE.

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM	
		ECN NO. REVISED PER BY: ECN: 4838 HM	MODEL(S) 8164 SHOWER
DRAWN: DO	DATE: 03/09/00	CHKD:	REV. 14
APPROVED:	DATE:	SCALE: 1/19	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 2 OF 2